


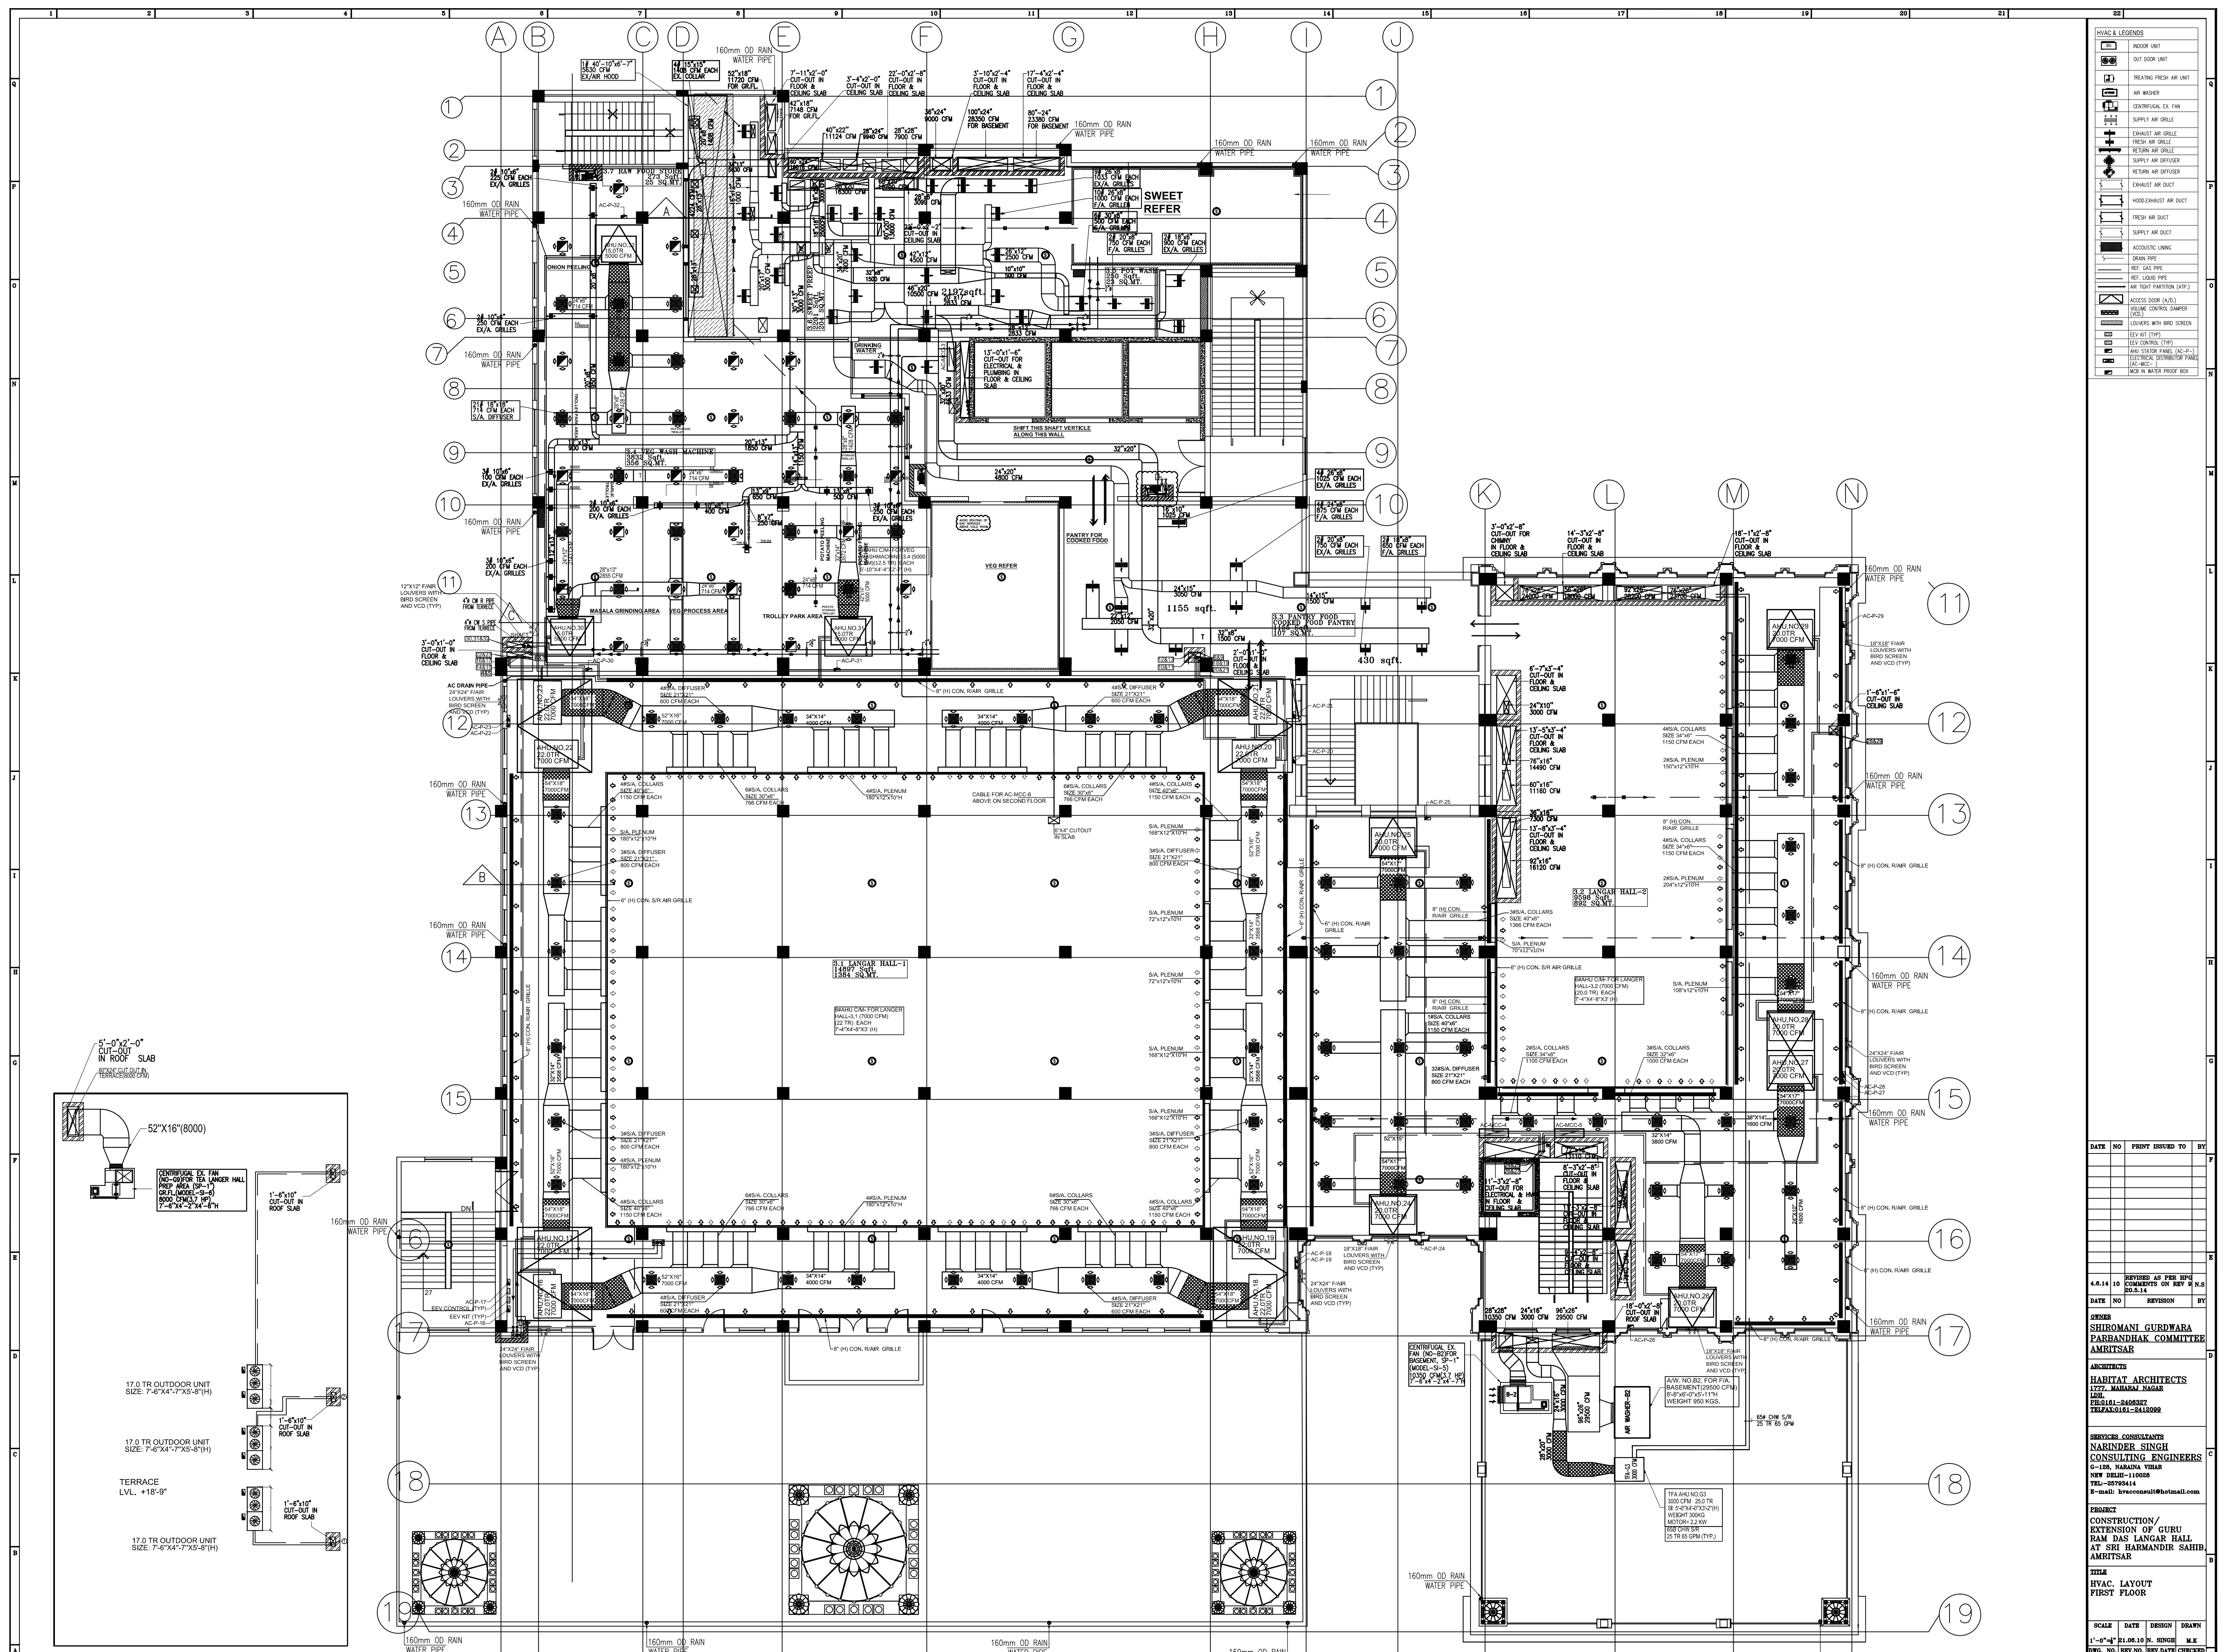

| HVAC & LEGENDS |                                        |
|----------------|----------------------------------------|
|                | INDOOR UNIT                            |
|                | OUT DOOR UNIT                          |
|                | TREATING FRESH AIR UNIT                |
|                | AIR WASHER                             |
|                | CENTRIFUGAL EX. FAN                    |
|                | SUPPLY AIR GRILLE                      |
|                | EXHAUST AIR GRILLE                     |
|                | FRESH AIR GRILLE                       |
|                | RETURN AIR GRILLE                      |
|                | SUPPLY AIR DIFFUSER                    |
|                | RETURN AIR DIFFUSER                    |
|                | EXHAUST AIR DUCT                       |
|                | HOOD/EXHAUST AIR DUCT                  |
|                | FRESH AIR DUCT                         |
|                | SUPPLY AIR DUCT                        |
|                | ACOUSTIC LINING                        |
|                | DRAIN PIPE                             |
|                | REF. GAS PIPE                          |
|                | RETURN AIR DUCT                        |
|                | AIR TIGHT PARTITION (A.T.P.)           |
|                | ACCESS DOOR (A.D.)                     |
|                | VOLUME CONTROL (V.C.)                  |
|                | LOUVERS WITH BIRD SCREEN               |
|                | EEV UNIT (TWP)                         |
|                | EEV CONTROL (TWP)                      |
|                | A.P. CONTROL PANEL (A.P.C.)            |
|                | ELECTRICAL DISTRIBUTION PANEL (A.E.C.) |
|                | MOISTURE IN WATER PROOF PANEL          |

[illegible]

|      |    |                                                 |      |
|------|----|-------------------------------------------------|------|
| 6.14 | 10 | REVISED AS PER HPG COMMENTS ON REV 9<br>20.5.14 | N.S. |
|------|----|-------------------------------------------------|------|

|      |    |          |    |
|------|----|----------|----|
| DATE | NO | REVISION | BY |
|------|----|----------|----|

**HIROMANI GURDWARA**  
**ARBANDHAK COMMITTEE**  
**AMRITSAR**

**HABITAT ARCHITECTS**  
777, MAHARAJ NAGAR  
DH.  
H:0161-2406327  
ELFAX:0161-2412099

**SERVICES CONSULTANTS**  
**HARINDER SINGH**  
**CONSULTING ENGINEERS**  
-128, NARAINA VIHAR  
NEW DELHI-110028  
TEL:-25793414  
-mail: hvacconsult@hotmail.com

**PROJECT**  
CONSTRUCTION/  
EXTENSION OF GURU  
RAM DAS LANGAR HALL  
AT SRI HARMANDIR SAHIB  
MUMBAI

**TITLE**  
HVAC. LAYOUT  
FIRST FLOOR

|          |          |           |         |
|----------|----------|-----------|---------|
| SCALE    | DATE     | DESIGN    | DRAWN   |
| -0"=1'   | 21.06.10 | N. SINGH  | M.K     |
| FIG. NO. | REV. NO. | REV. DATE | CHECKED |